


LIFE SAFETY SYSTEMS, INC.®



PHONE 802-879-5355

FAX 802-879-4574

IN VERMONT 1-800-649-9995

FIRE ALARM SYSTEM
Test & Inspection Report
VERMONT PROOF OF INSPECTION STICKER # 08-16534
SYSTEM IDENTIFICATION # F-18123

Customer: Richards Apartments – 361 Pearl Street

Date: June 18, 2008

Contact: Gene Richards

Location: 361 Pearl Street, Burlington

Time: Start: 11:15 End: 11:45 Total: 0:30

Techs Sent: KH, HO

Panel Make & Model: Silent Knight 5208

Date Installed: June 2007

Power Supply (12Ah)

AC Line: 121.4 AC
Charge Rate: 27.3 DC

Battery Voltage Under Load

Starting: 27.0 DC
Ending: 25.5 DC

Manual Pull Stations Qty: 7 # Zones: 4 Tested: 7

Signal Horn/Strobes Qty: 5 # Zones: 1 Tested: 5

Signal Horn/Strobes WP Qty: 2 # Zones: 1 Tested: 2
Horn Only Qty: 12 # Zones: 4 Tested: 12

Automatic Detection

Photoelectric Smokes Qty: 5 # Zones: 4 Tested: 5
Sprinkler Tamper Qty: 2 # Zones: 1 Tested: 2
Sprinkler Flow Qty: 1 # Zones: 1 Tested: 1
AC/DC CO Smokes Qty: 49 # Zones: NA Tested: N/A
System CO Detector Qty: 1 # Zones: 1 Tested: 1

Auxiliary Features

None


Deficiencies Found

1) None

Action Taken

1) N/A

Comments: 1) Front exit door Apartment #3 is Exit of Convenience and has no pull station. 2) AC smoke CO's tested 6/08 by licensed electrician #EM4336, deficiencies corrected.

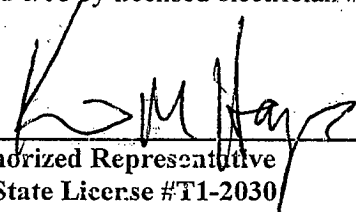
Authorized Representative
VT State License #T1-2030


Reviewed by # T1-1059

CC: VT Department of Public Safety - Williston
Burlington Fire Department - Burlington