


LIFE SAFETY SYSTEMS, INC.®

P.O. Box 76, Essex Jct., VT 05453-0076

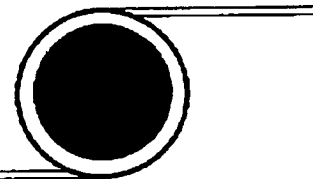

PHONE 802-879-5355

FAX 802-879-4574

IN VERMONT 1-800-649-9995

FIRE ALARM SYSTEM
 Test & Inspection Report
 VERMONT PROOF OF INSPECTION STICKER # 09-03422
 SYSTEM IDENTIFICATION # F-18123

Customer: Richards Apartments – 361 Pearl Street

Date: June 19, 2009

Contact: Gene Richards

Location: 361 Pearl Street, Burlington

Time: Start: 11:00 End: 12:30 Total: 1:30

Techs Sent: KH, RR

Panel Make & Model: Silent Knight 5208

Date Installed: June 2007

	(Ah)	<u>AC Line</u>	<u>DC Charge Rate</u>	<u>Battery Voltage Under Load</u>	
				<u>DC Starting</u>	<u>DC Ending</u>
Power Supply (12)		120.6	27.3	26.9	26.1
<u>Manual Pull Stations</u>		Qty: 7	# Zones: 4	Tested: 7	
<u>Signal Horn/Strobes</u>		Qty: 5	# Zones: 1	Tested: 5	
<u>Signal Horn/Strobes WP</u>		Qty: 2	# Zones: 1	Tested: 2	
Horns Only		Qty: 12	# Zones: 4	Tested: 12	
<u>Automatic Detection</u>					
Photoelectric Smokes		Qty: 5	# Zones: 4	Tested: 5	
Sprinkler Tamper		Qty: 2	# Zones: 1	Tested: 2	
Sprinkler Flow		Qty: 1	# Zones: 1	Tested: 1	
AC/DC CO Smokes		Qty: 49	# Zones: NA	Tested: 43	
System CO Detector		Qty: 1	# Zones: 1	Tested: 1	

Auxiliary Features

None


Deficiencies Found

- 1) Apt 2 bedroom combo unit across from bathroom failed
- 2) Apt 5 right hall combo and all right bedroom combos do not trip others


Action Taken

- 1-2) To be corrected by
 Brian Ladd Electricians
 DONE 8.13.09

Comments: 1) Front exit door Apartment #3 is Exit of Convenience and has no pull station

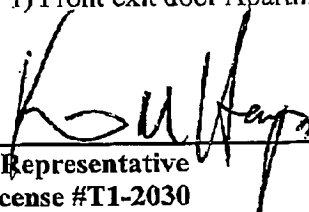

 Authorized Representative
 VT State License #T1-2030



 Reviewed by #/T1-1059

CC: VT Department of Public Safety - Williston
 Burlington Fire Department - Burlington