


LIFE SAFETY SYSTEMS, INC.®

P.O. Box 76, Essex Jct., VT 05453-0076



PHONE 802-879-5355

FAX 802-879-4574

IN VERMONT 1-800-649-9995

FIRE ALARM SYSTEM
Test & Inspection Report
VERMONT PROOF OF INSPECTION STICKER # 11-09835
SYSTEM IDENTIFICATION # F-27417

Customer: Richards Apartments – 355 Pearl St.

Date: June 3, 2011

Contact: Gene Richards

Location: 355 Pearl St., Burlington

Time: Start: 12:30 End: 14:45 Total: 2:15

Techs Sent: SA, CB

Panel Make & Model: Silent Knight 5208

Date Installed: July 7, 2010

| | (Ah) | <u>AC Line</u> | <u>DC Charge Rate</u> | <u>Battery Voltage Under Load</u> | |
|-----------------------------|------|----------------|-----------------------|-----------------------------------|------------------|
| | | | | <u>DC Starting</u> | <u>DC Ending</u> |
| Power Supply (7) | | 122.4 VAC | 25.6 VDC | 24.9 | 23.6 |
| <u>Manual Pull Stations</u> | | Qty: 7 | # Zones: 3 | Tested: 7 | |
| <u>Signal Horn/Strobes</u> | | Qty: 6 | # Zones: 2 | Tested: 6 | |
| Apartment Horns | | Qty: 14 | # Zones: 4 | Tested: 14 | |
| AC Strobes | | Qty: 4 | # Zones: N/A | Tested: 4 | |
| <u>Automatic Detection</u> | | | | | |
| Photoelectric Smokes | | Qty: 4 | # Zones: 2 | Tested: 4 | |
| CO Detectors | | Qty: 1 | # Zones: 1 | Tested: 1 | |
| AC Smoke/CO Combo Units | | Qty: 53 | # Zones: N/A | Tested: 53 | |
| Sprinkler Water Flow | | Qty: 1 | # Zones: 1 | Tested: 1 | |
| Sprinkler Tamper | | Qty: 1 | # Zones: 1 | Tested: 1 | |

Notes: All AC detectors tested and cleaned except FireX detectors. FireX brand detectors, if any, were tested with push button and not cleaned, in compliance with manufacturer's instructions.

Auxiliary Features

None


Deficiencies Found


1) None

Action Taken

1) N/A

Comments: 1) Stairwell AC combo unit tandem with Apt 6. 2) Boiler Room AC combo tandem with Apt 1.

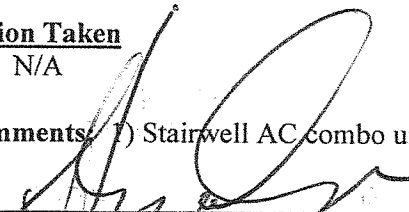
Authorized Representative
VT State License #T1-2031


Reviewed by #T1-1059

cc: VT Department of Public Safety - Williston
Burlington Fire Department